


066
067
068
069
070
071
072
073
074
075
076
077
078
079
080
081
082
083
084
085
086
087
088
089
090
091
092
093
094
095
096
097
098
099
100
101
102
103
104
105
106
107
108
109
110
111
112
113
114
115
116
117
118
119
120

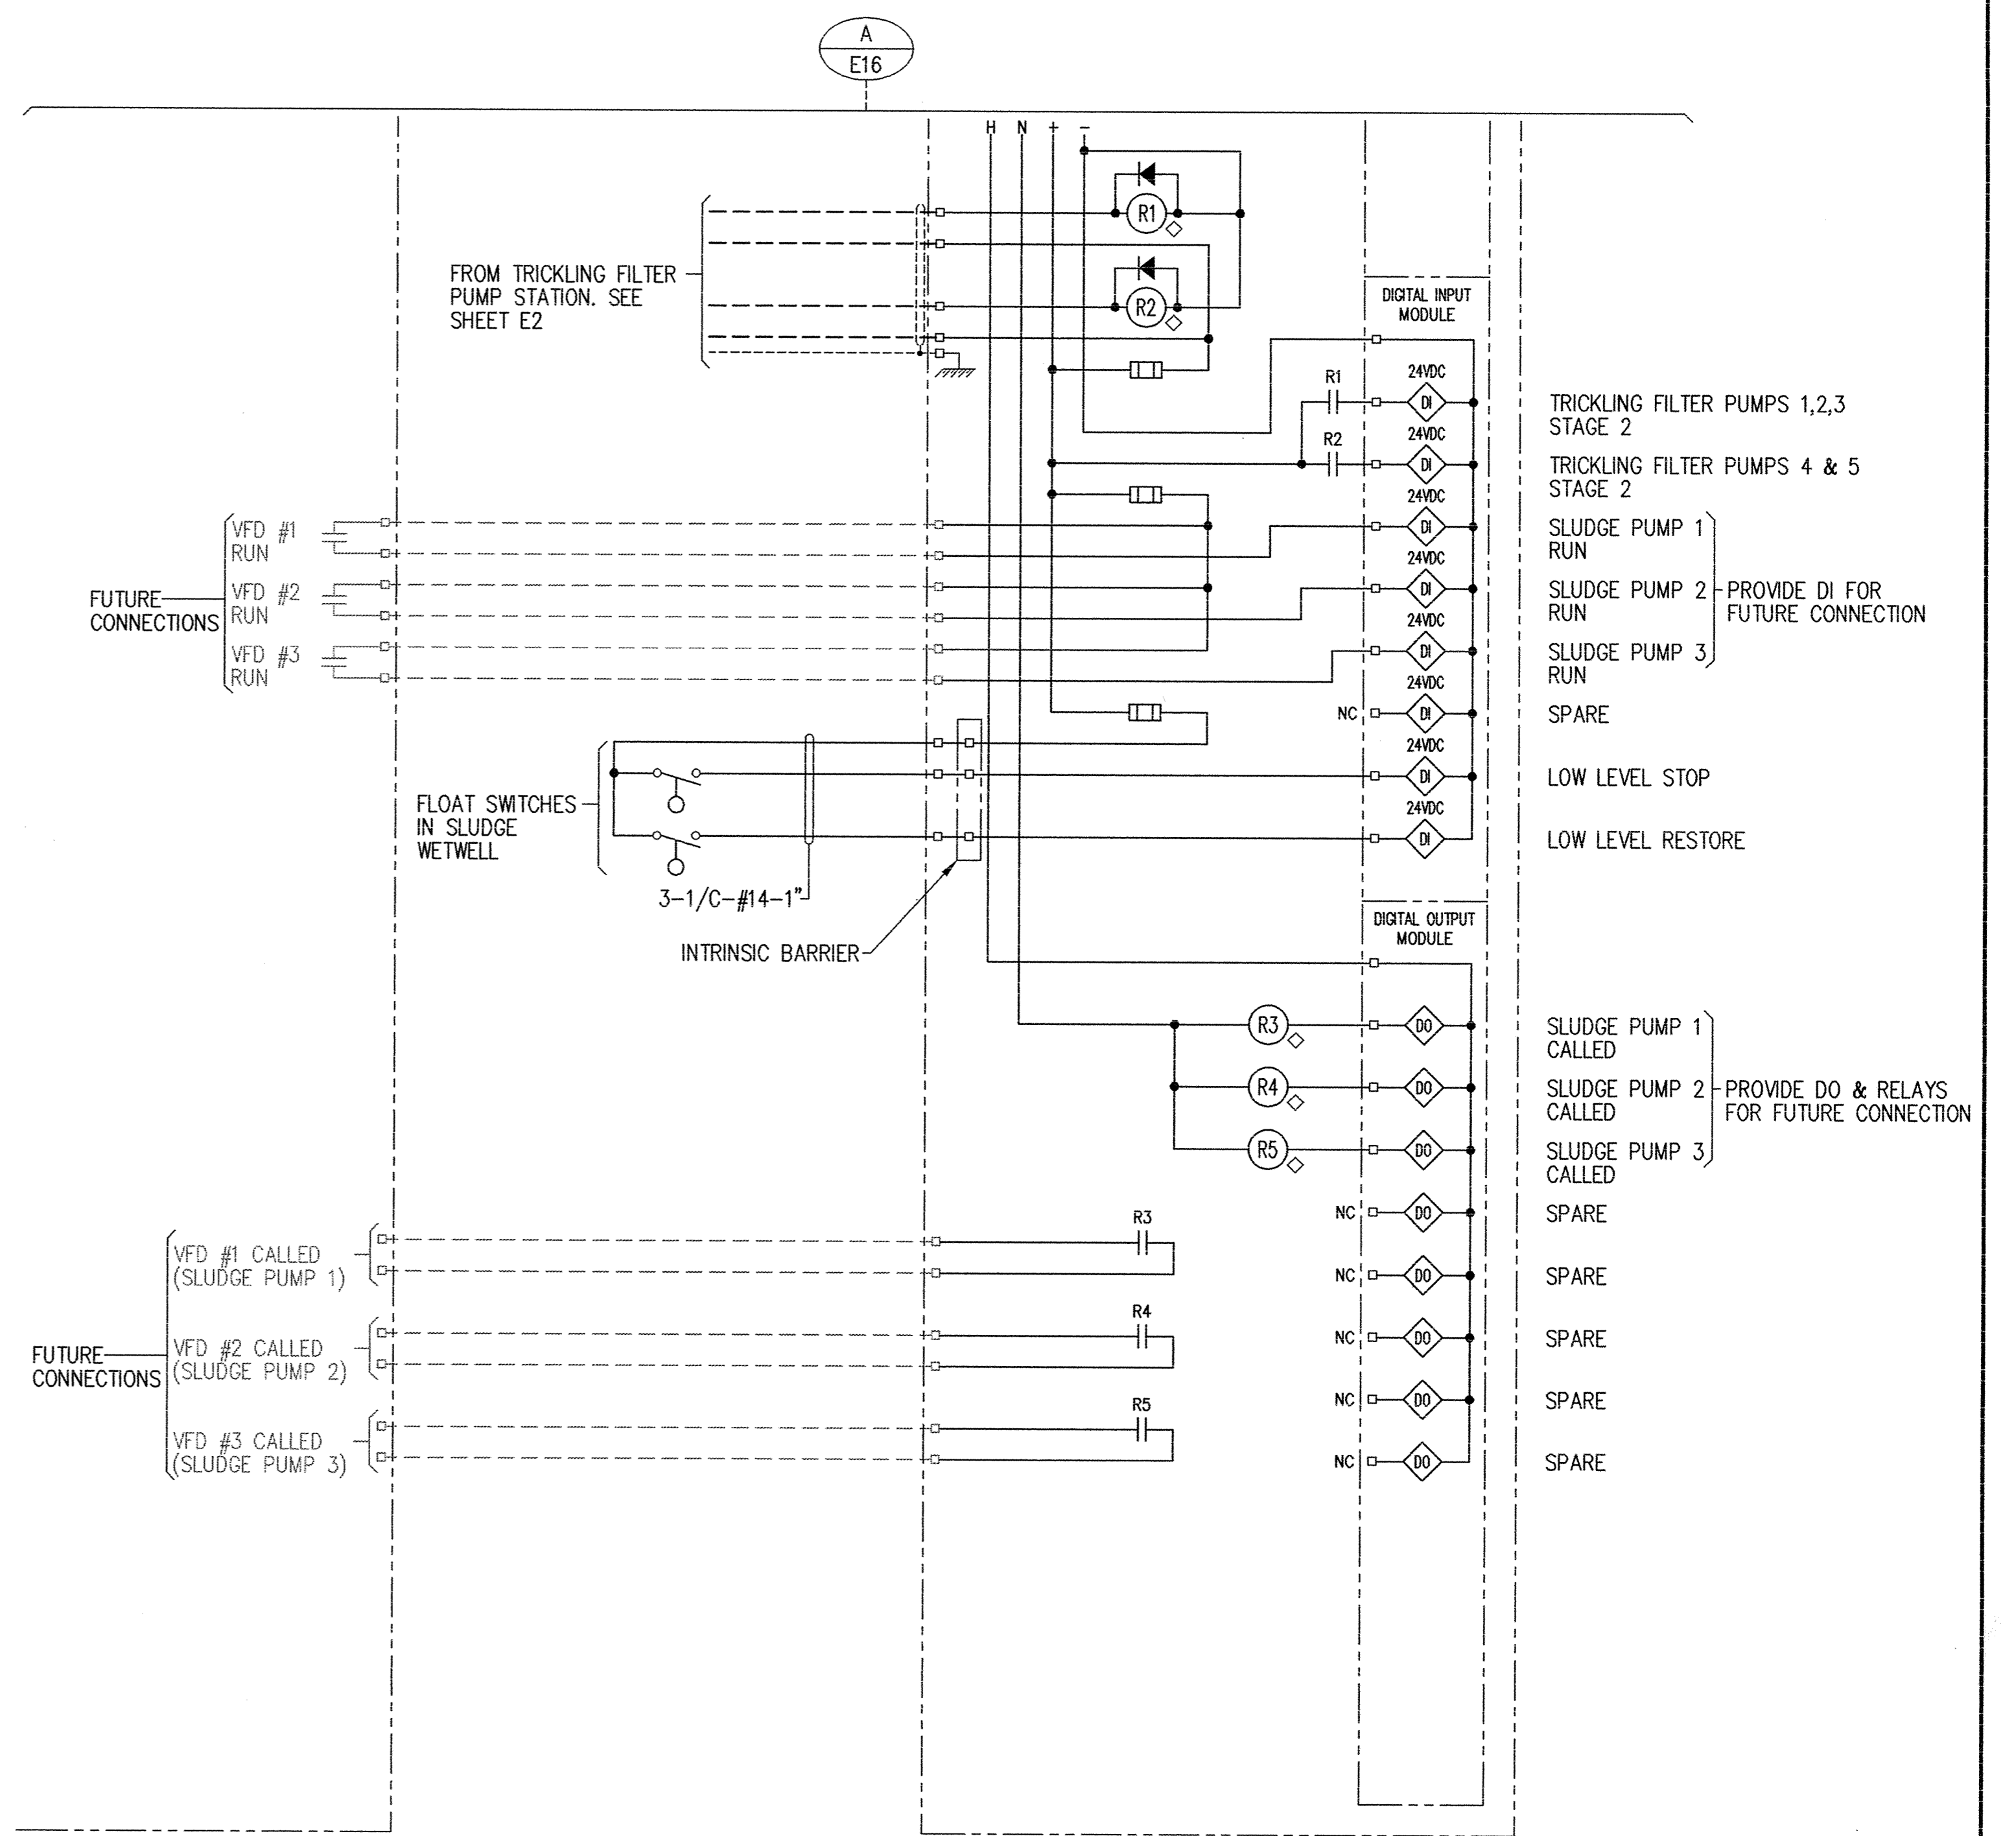

CONTROL BUILDING CONTROL PANEL SCHEMATIC
NO SCALE

- CONTROL PANEL GENERAL NOTES**
1. MODIFY SCHEMATIC AS REQUIRED FOR UL508 LABEL AT NO ADDITIONAL COST TO THE OWNER. SEE SPECIFICATION SECTION 16950.
 2. ORGANIZE & LACE ALL WIRING USING NYLON CABLE TIES.
 3. ADD THE COMPONENTS & WIRING SHOWN ON THIS DRAWING TO THE EXISTING CONTROL PANEL.

PLC SYMBOLS		LEGEND	
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	DIGITAL OUTPUT (CONTACT)		PANEL WIRING
	DIGITAL INPUT, REMOTELY POWERED (120VAC UNLESS NOTED OTHERWISE)		FIELD WIRING
	ANALOG OUTPUT, 4-20mADC (SELF-POWERED)		EXISTING WIRING
	ANALOG INPUT, 4-20mADC (UNLESS NOTED OTHERWISE)		CONDUCTOR SHIELD

This drawing was prepared by:
Reading & Associates, Inc.
7300 France Avenue South
Suite 330
Minneapolis, MN 55435
Telephone: (612) 831-0317
Fax: (612) 831-2179

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY REGISTERED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.

[Signature]
DATE 06 OCT 95 REG. NO. 9955



1326 ENERGY PARK DRIVE
ST. PAUL, MINNESOTA 55108
(612) 644-4389

5075 WAYZATA BLVD. SUITE 225
MINNEAPOLIS, MINNESOTA 55441
(612) 546-0432

REVISIONS	DATE	DESCRIPTION	DESIGNED	PKF

GRAPHIC SCALE
0 HORIZ.
0 VERT.