


277/480V, 3Ø, 4W, 800A BUSSING BRACED FOR 42,000 AMPS RMS W/ NEUTRAL PAD - FUTURE

B  
E8

C  
E9

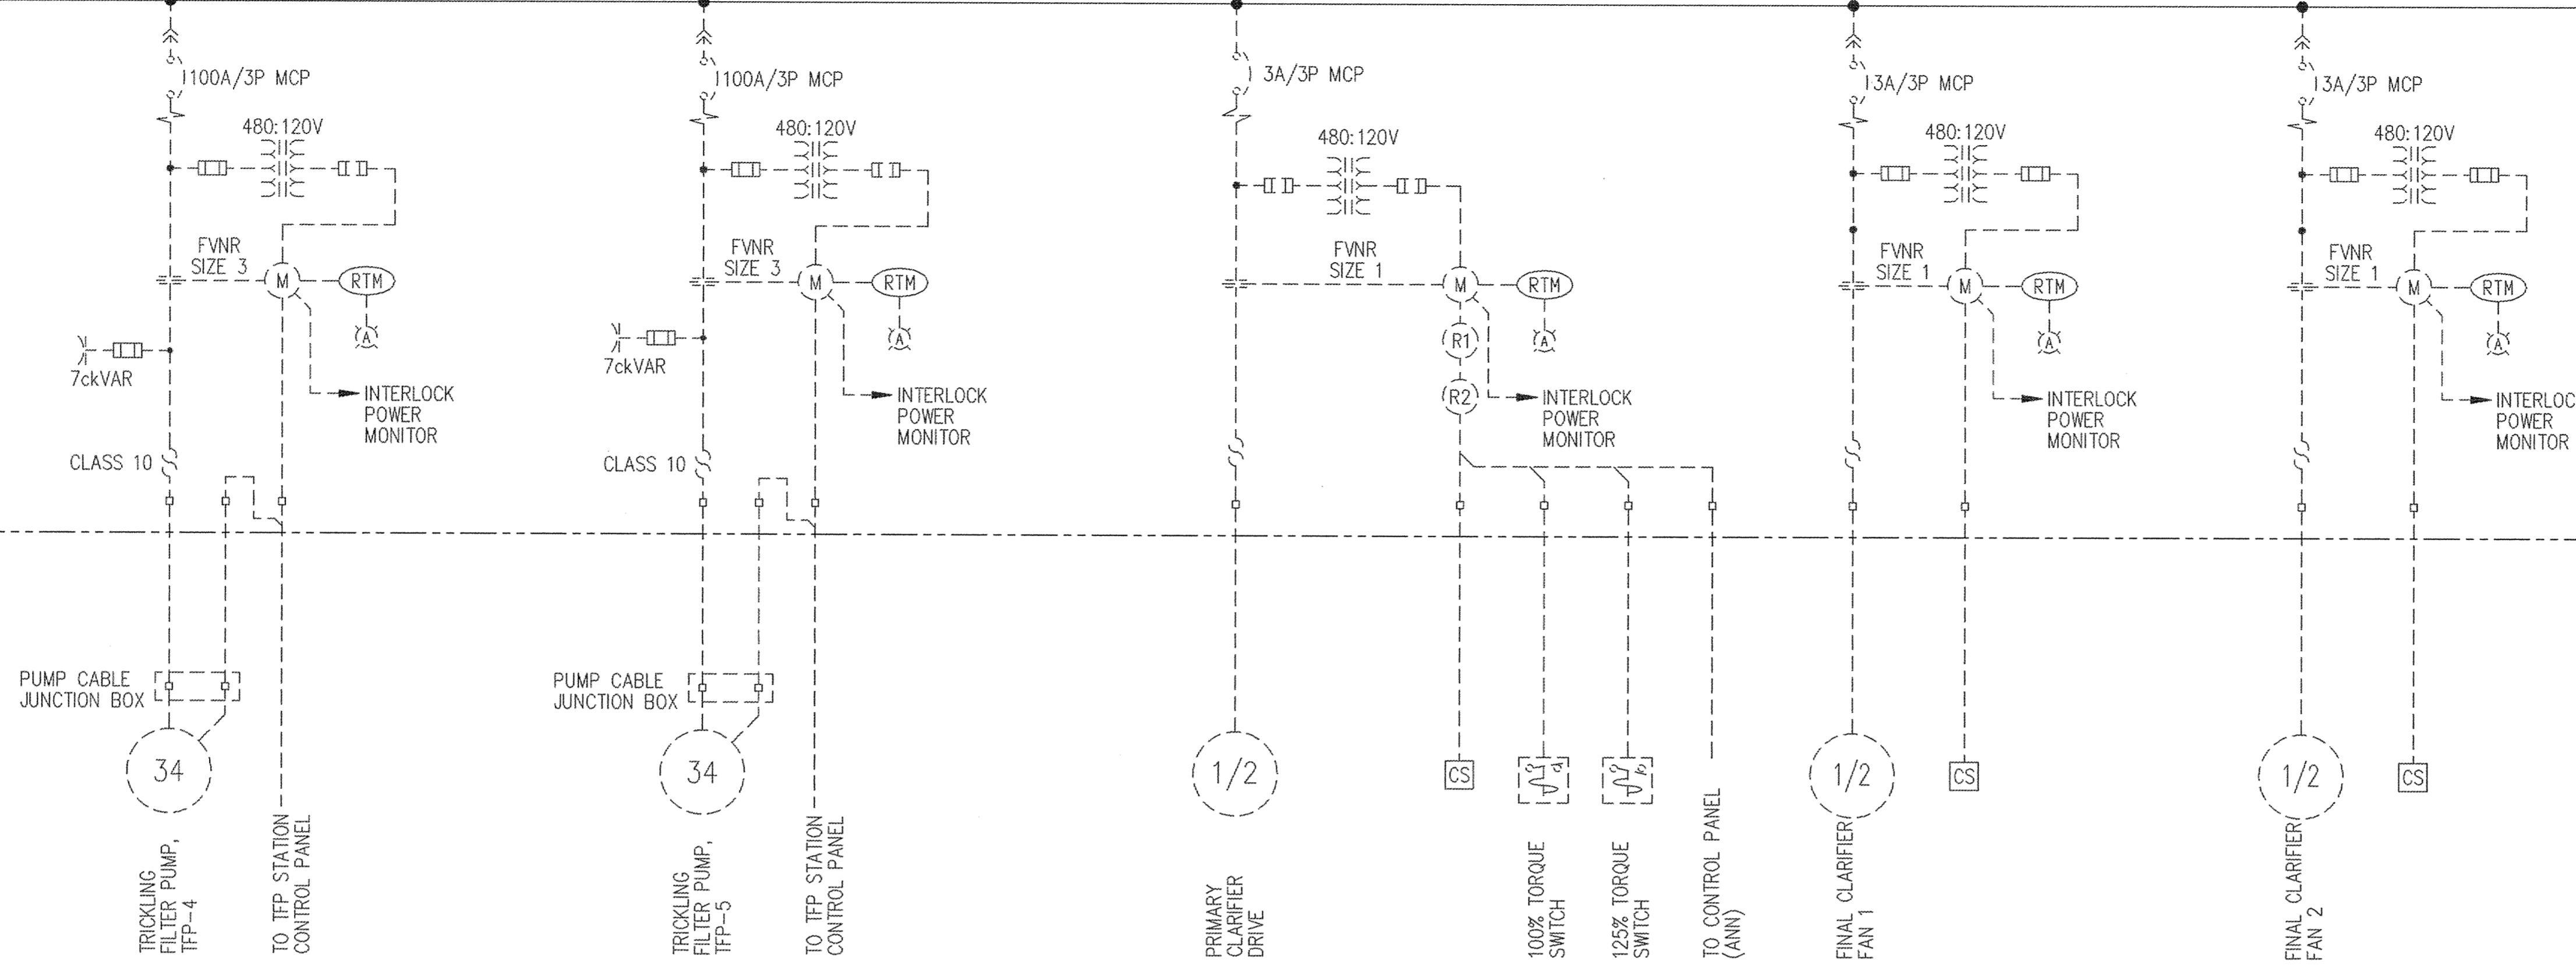


FUTURE TRICKLING FILTER PUMP STATION MOTOR CONTROL CENTER (MCC) ONE-LINE DIAGRAM

NO SCALE

CONTINUED ON SHEET E8 & BELOW

C  
E9

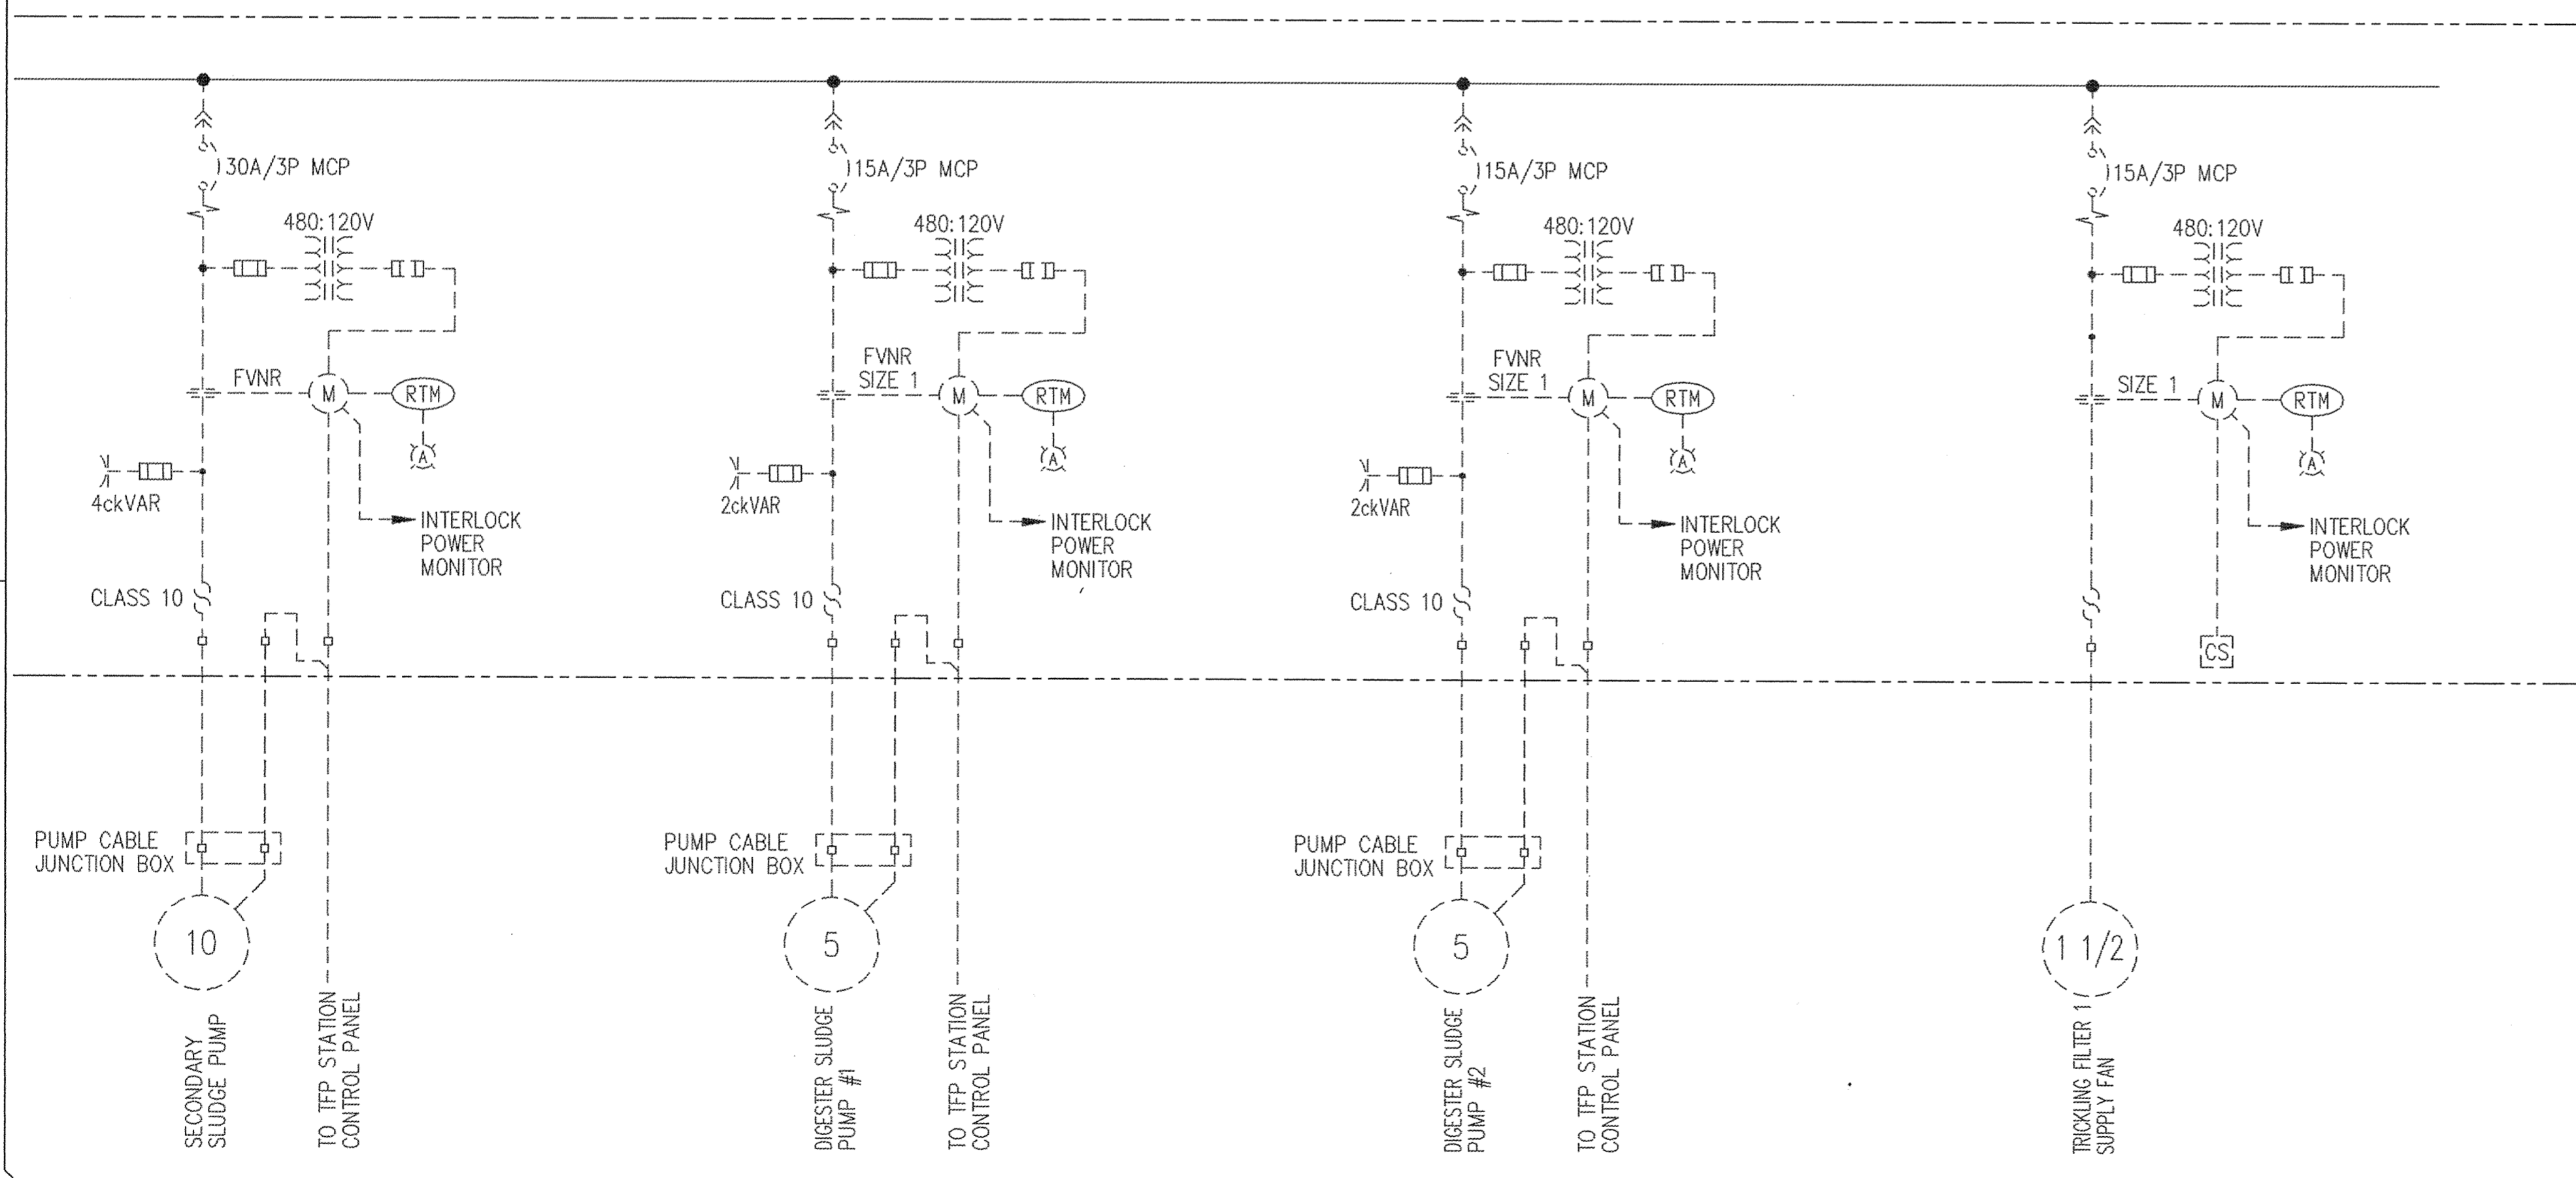

FUTURE TRICKLING FILTER PUMP STATION MOTOR CONTROL CENTER (MCC) ONE-LINE DIAGRAM

NO SCALE

CONTINUED ABOVE

NOTE: THIS SHEET IS FOR FUTURE REFERENCE ONLY

LEGEND	
SYMBOL	DESCRIPTION
△	MOTOR CONTROL CENTER MOUNTED
*	FIELD MOUNTED
◇	CONTROL PANEL MOUNTED

This drawing was prepared by:  
 Kaebling & Associates, Inc.  
 7300 France Avenue South  
 Suite 330  
 Minneapolis, MN 55435  
 Telephone: (612) 831-0317  
 Fax: (612) 831-2179

I HEREBY CERTIFY THAT THIS PLAN, SPECIFICATION, OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY REGISTERED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.

*[Signature]*  
 DATE: 12/1/99 REG. NO. 9955



1326 ENERGY PARK DRIVE  
 ST. PAUL, MINNESOTA 55108  
 (612) 644-4389

9800 SHELARD PARKWAY  
 MINNEAPOLIS, MINNESOTA 55441  
 (612) 546-0432

DATE	DESCRIPTION	DESIGNED	PFK
		CHECKED	PFK
		DRAWN	DTB
GRAPHIC SCALE			
0 HORIZ.			
0 VERT.			

CITY OF ELK RIVER  
 WASTEWATER TREATMENT FACILITIES  
 MCC ONE-LINE DIAGRAM (FUTURE)

E9