


WATER LEVELS

GRIT TANK	911.50
PRIMARY CLARIFIER No. 1	909.00
PRIMARY CLARIFIER No. 2	908.95
PRIMARY DIGESTER	913.58
SECONDARY DIGESTER	912.58
FINAL CLARIFIER No. 1 & 2	898.30
CHLORINATION TANK	895.00
DISC TANKS	902.00

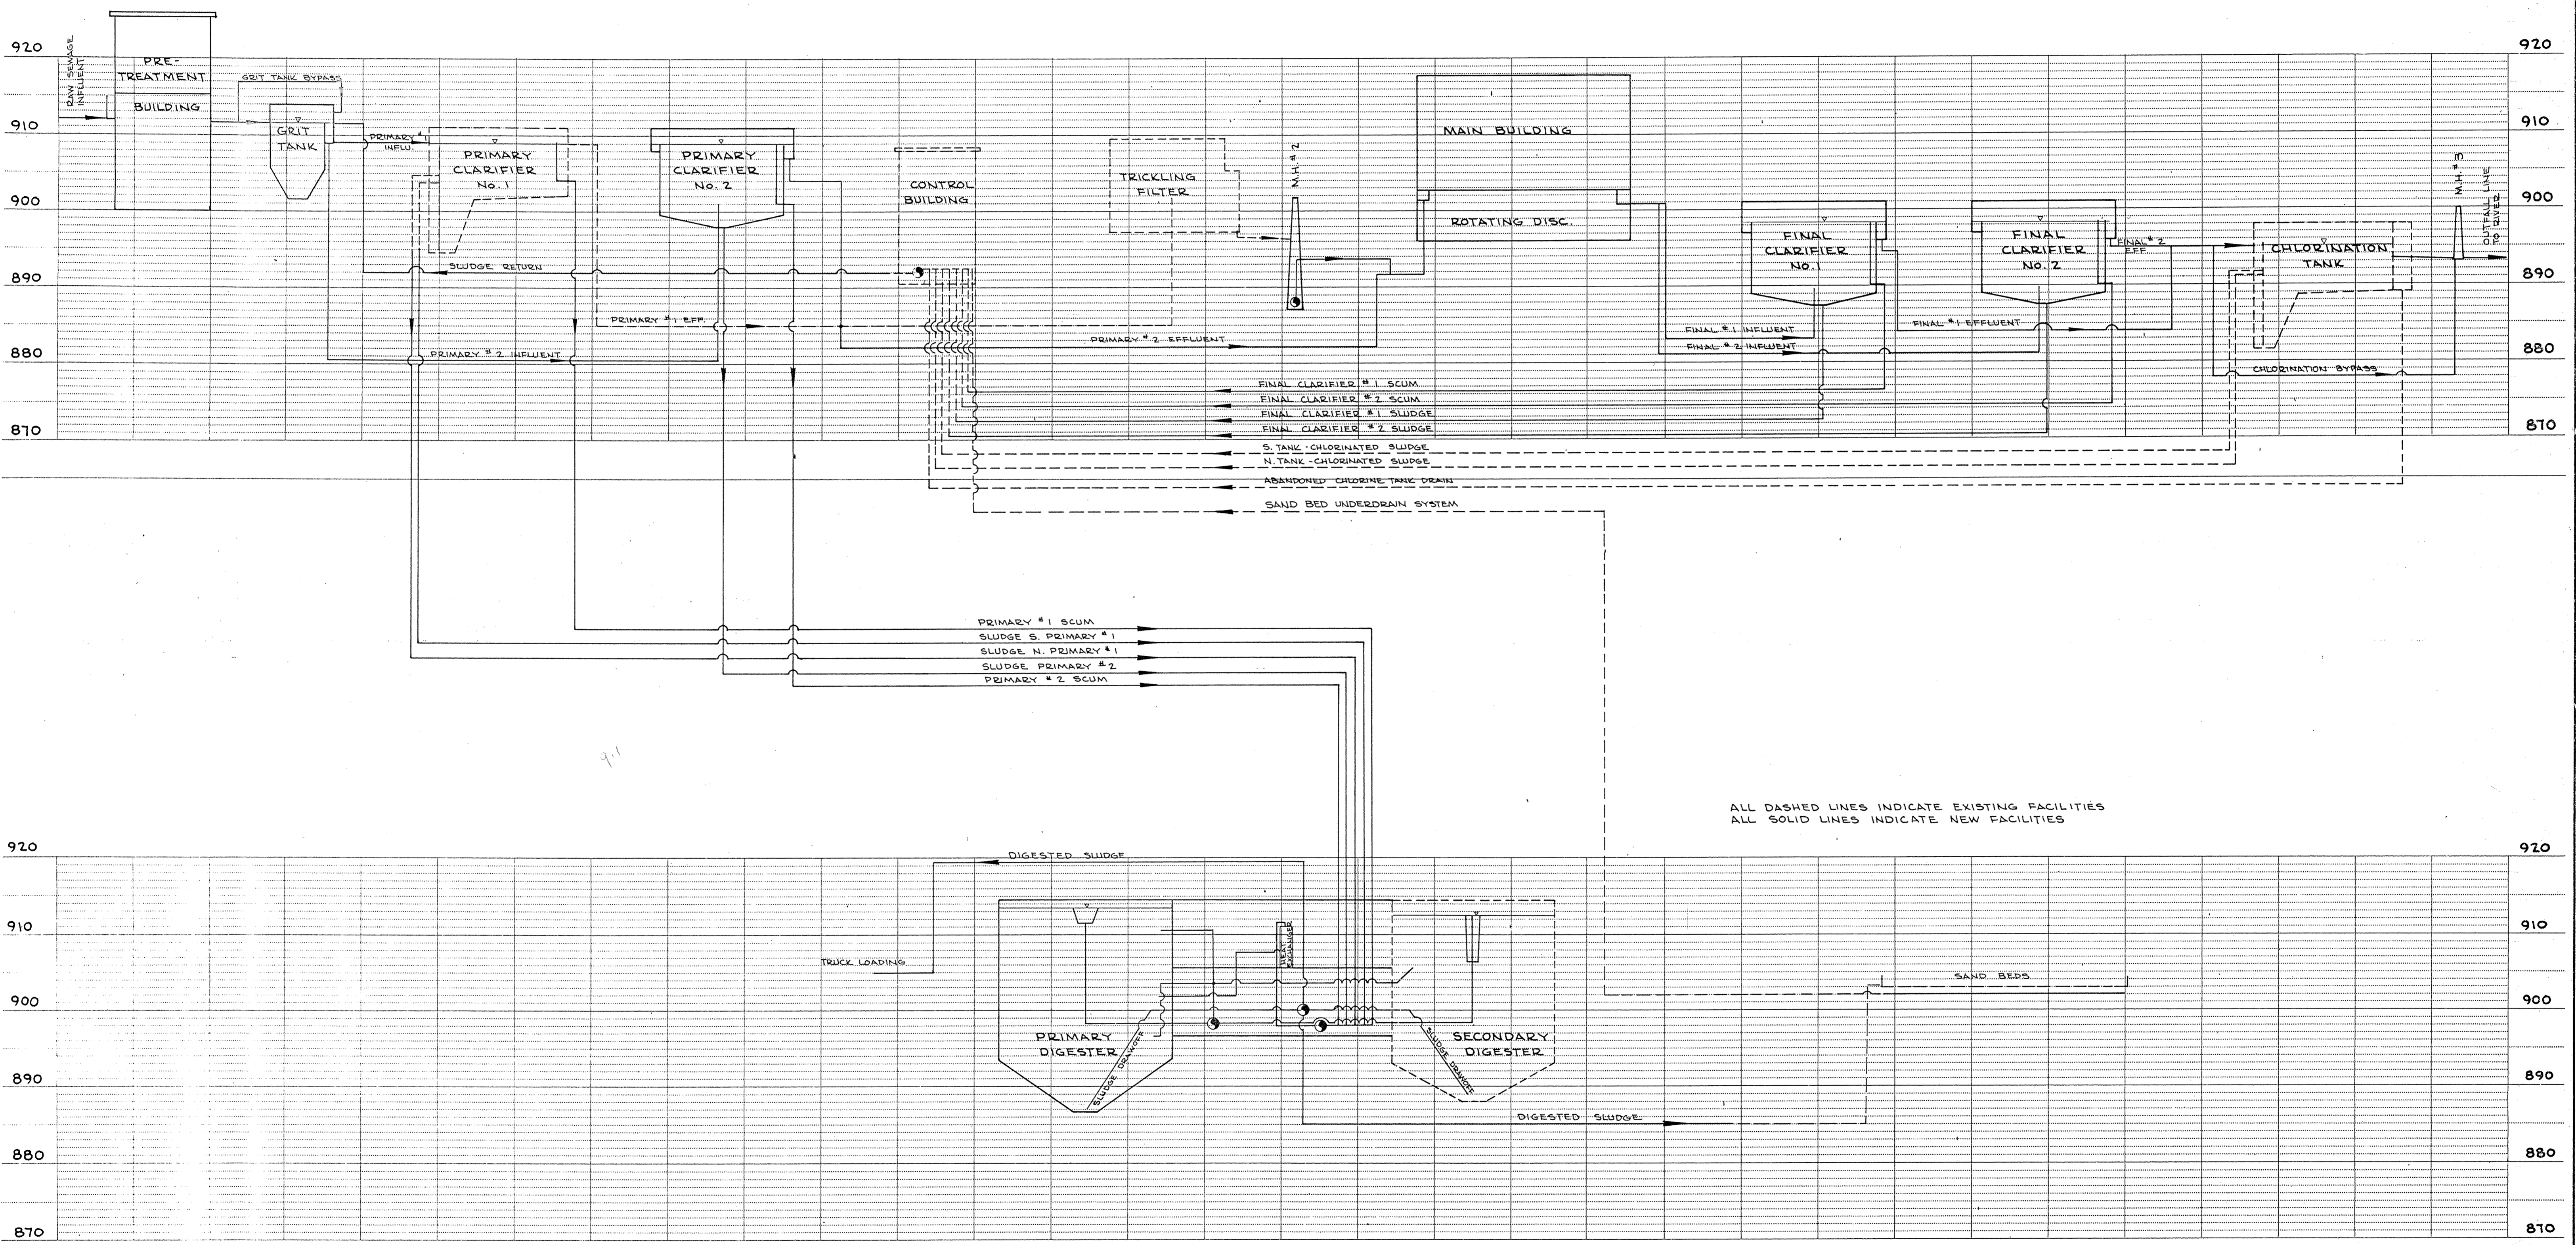

NO.	DATE	BY	REVISIONS
C.	2-23-77	J.R.C.	REMOVED TWO MANHOLES
B.	9-23-76	J.R.C.	ADDED LINE FROM SAND BED UNDERDRAINS
A.	7-6-76	J.R.C.	MISC. REVISIONS

DESIGNED	K.L.V.	CHECKED	K.L.V.
DRAWN	J.R.C.	APPROVED	W.H.M.
DATE	8/29/75	COMM.	

I HEREBY CERTIFY THAT THIS PLAN WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY REGISTERED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MINNESOTA.
Karen L. Van Oackbeek
DATE *Aug 29, 1975* REG. NO. *10159*



WASTE WATER TREATMENT FACILITIES
FOR
ELK RIVER, MINNESOTA

SCALE	AS NOTED
BOOK	PAGE
FILE NO.	2603

SCHEMATIC FLOW DIAGRAM

SHEET	REV.
2	C
OF	31