


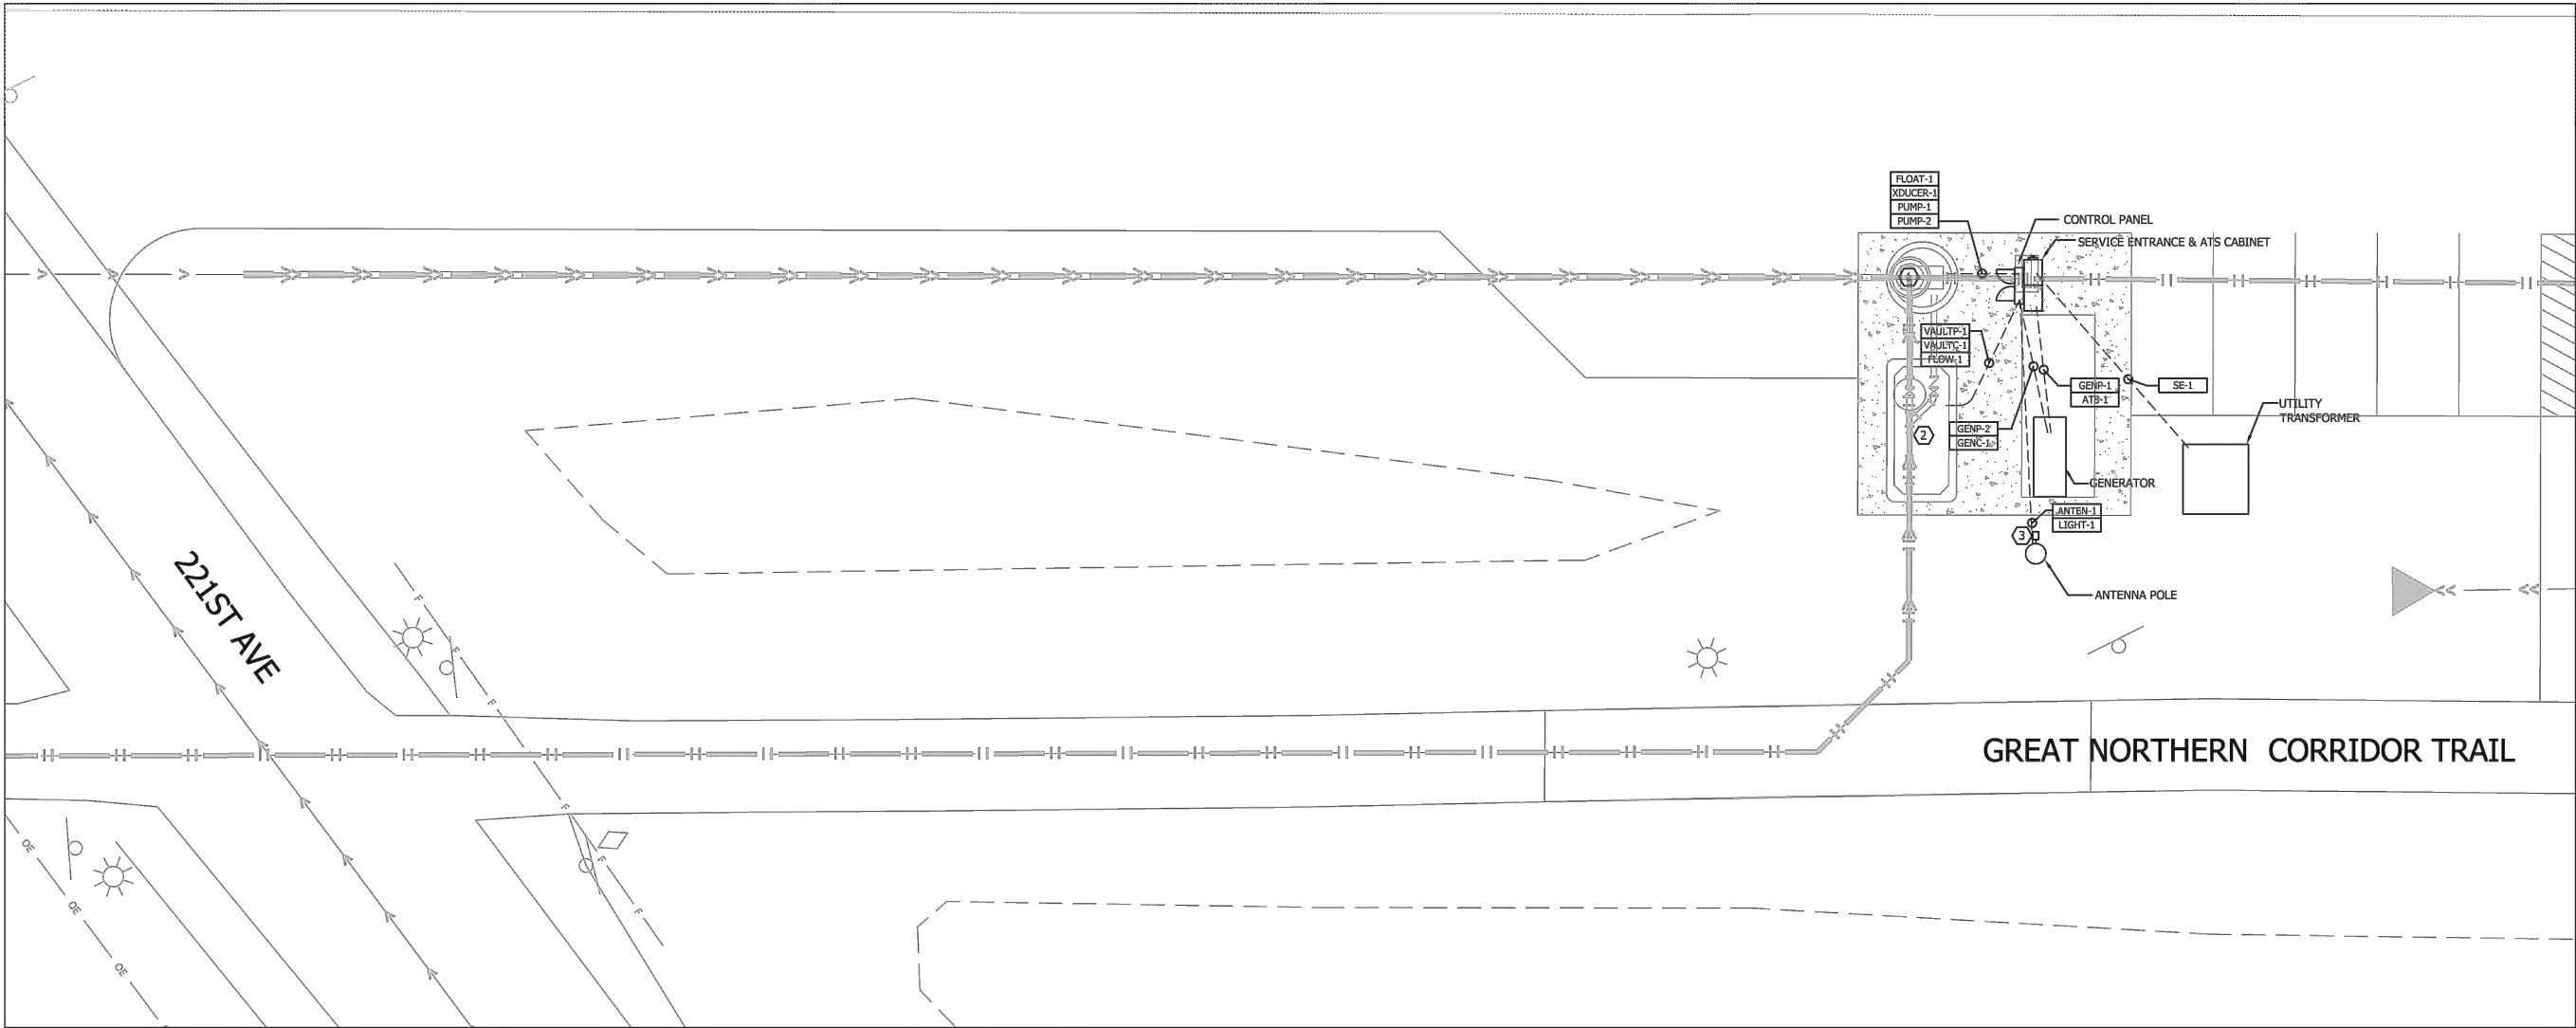

GENERAL NOTES:

- COORDINATE FINAL LOCATION OF UTILITY TRANSFORMER WITH ELECTRIC UTILITY.
- COORDINATE NATURAL GAS SERVICE WITH UTILITY. CONTRACTOR IS RESPONSIBLE FOR PROVIDING THE GAS SERVICE TO THE GENERATOR.
- VERIFY LOCATIONS OF UNDERGROUND UTILITIES PRIOR TO PLACEMENT OF EQUIPMENT AND ANY EARTHWORK.
- COORDINATE DIMENSIONS OF PROVIDED EQUIPMENT WITH CONCRETE SUPPLIER.
- PAD MOUNTED EQUIPMENT SHALL NOT BE LOCATED IN A HAZARDOUS LOCATION.
- COORDINATE REQUIREMENTS FOR GENERATOR PAD WITH ALL TRADES.

KEYEDNOTES:

- AN AREA ABOVE GRADE 3' IN DIAMETER AROUND THE OPENING OF THE WETWELL HATCH IS A CLASS 1, DIVISION 2 HAZARDOUS LOCATION. WET WELL IS A CLASS 1, DIVISION 1 HAZARDOUS LOCATION.
- BELOW GRADE VALVE VAULT IS A CLASS 1, DIVISION 2 HAZARDOUS LOCATION.
- PROVIDE LITHONIA DSX1, OR EQUAL LED LUMINAIRE ON POLE. LUMINAIRE TO BE 4000K, TYPE 4 OPTICS, 15,000 LUMEN OUTPUT.

1 CITY LIFT STATION - ELECTRICAL SITE PLAN

